**Jamesville** 2022 ~

The Division of Water Resources (DWR) provides the data contained within this Local Water Supply Plan (LWSP) as a courtesy and service to our customers. DWR staff does not field verify data. Neither DWR, nor any other party involved in the preparation of this LWSP attests that the data is completely free of errors and omissions. Furthermore, data users are cautioned that LWSPs labeled PROVISIONAL have yet to be reviewed by DWR staff. Subsequent review may result in significant revision. Questions regarding the accuracy or limitations of usage of this data should be directed to the water system and/or DWR.

Complete

## 1. System Information

**Contact Information** 

PWSID: 04-59-030 Water System Name: Jamesville PO Box 215

Mailing Address: Ownership: Municipality Jamesville, NC 27846

Contact Person: Samuel Lilley Title: Supervisor 252-792-5006 Phone: Cell/Mobile: 252-809-2174

Secondary Contact: Mike Houston Phone: 919-812-6088

Mailing Address: Cell/Mobile:

, NC 28525

**Distribution System** 

Line Type Size Range (Inches) Estimated % of lines

Asbestos Cement 12 2.00 % Polyvinyl Chloride 2-12 98.00 %

What are the estimated total miles of distribution system lines? 8 Miles

How many feet of distribution lines were replaced during 2022? 0 Feet

How many feet of new water mains were added during 2022? 0 Feet

How many meters were replaced in 2022? 8

How old are the oldest meters in this system? 51 Year(s)

How many meters for outdoor water use, such as irrigation, are not billed for sewer services? 0

What is this system's finished water storage capacity? 0.1000 Million Gallons

Has water pressure been inadequate in any part of the system since last update? Line breaks that were repaired quickly should not be included. No

#### **Programs**

Does this system have a program to work or flush hydrants? Yes, Semi-Annually

Does this system have a valve exercise program? Yes, Annually

Does this system have a cross-connection program? No

Does this system have a program to replace meters? Yes

Does this system have a plumbing retrofit program? No

Does this system have an active water conservation public education program? No

Does this system have a leak detection program? Yes

As employees ride throughout the system they are looking for leaks and monitor the meter at the water facility. The Town also utilizes NCRWA for leak detection on an as needed bases.

What type of rate structure is used? Flat/Fixed

How much reclaimed water does this system use? 0.0000 MGD For how many connections? 0

Does this system have an interconnection with another system capable of providing water in an emergency? No

Martin County Water System is 3 miles away across Gardner Creek from town.

### 2. Water Use Information

Service Area

Sub-Basin(s) % of Service Population County(s) % of Service Population

Roanoke River (14-1) 100 % Martin 100 %

What was the year-round population served in 2022? 440 Has this system acquired another system since last report? No

Water Use by Type

| Type of Use   | Metered<br>Connections | Metered<br>Average Use (MGD) | Non-Metered<br>Connections | Non-Metered<br>Estimated Use (MGD) |
|---------------|------------------------|------------------------------|----------------------------|------------------------------------|
| Residential   | 149                    | 0.0156                       | 0                          | 0.0000                             |
| Commercial    | 15                     | 0.0047                       | 0                          | 0.0000                             |
| Industrial    | 3                      | 0.0012                       | 0                          | 0.0000                             |
| Institutional | 10                     | 0.0002                       | 0                          | 0.0000                             |

How much water was used for system processes (backwash, line cleaning, flushing, etc.)? 0.0058 MGD

## 3. Water Supply Sources

Monthly Withdrawals & Purchases

|     | Average Daily<br>Use (MGD) | Max Day<br>Use (MGD) |     | Average Daily<br>Use (MGD) | Max Day<br>Use (MGD) |     | Average Daily<br>Use (MGD) | Max Day<br>Use (MGD) |
|-----|----------------------------|----------------------|-----|----------------------------|----------------------|-----|----------------------------|----------------------|
| Jan | 0.0299                     |                      | May | 0.0328                     |                      | Sep | 0.0320                     |                      |
| Feb | 0.0311                     |                      | Jun | 0.0312                     |                      | Oct | 0.0292                     |                      |
| Mar | 0.0306                     |                      | Jul | 0.0320                     |                      | Nov | 0.0286                     |                      |
| Apr | 0.0302                     |                      | Aug | 0.0314                     |                      | Dec | 0.0329                     |                      |



**Ground Water Sources** 

| Name or<br>Number |        | aily Withdrawal<br>MGD) | Max Day Withdrawal<br>(MGD) | 12-Hour<br>Supply | CUA<br>Reduction | Year<br>Offline | Use Type  |
|-------------------|--------|-------------------------|-----------------------------|-------------------|------------------|-----------------|-----------|
| Number            | MGD    | Days Used               | (IVIGD)                     | (MGD)             | Reduction        | Offilite        |           |
| Well 1            | 0.0310 | 365                     | 0.0616                      | 0.1440            | CUA0             |                 | Regular   |
| Well 2            | 0.0000 | 0                       | 0.0000                      | 0.1220            | CUA0             |                 | Emergency |

**Ground Water Sources (continued)** 

| Name or Number | Well Depth (Feet)  | Casing Depth | Screen Depth (Feet) |        | Well Diameter (Inches) | Pump Intake Depth (Feet)    | Metered? |  |
|----------------|--------------------|--------------|---------------------|--------|------------------------|-----------------------------|----------|--|
| Name of Number | Well Deptil (Leet) | (Feet)       |                     | Bottom | Well Diameter (Inches) | r ump intake Deptir (r eet) |          |  |
| Well 1         | 200                | 120          | 120                 | 192    | 8                      | 100                         | Yes      |  |
| Well 2         | 200                | 130          | 130                 | 197    | 8                      | 40                          | No       |  |

Are ground water levels monitored? Yes, Weekly

Does this system have a wellhead protection program? Yes

Plant Name Permitted Capacity Is Raw Wa

0.1000

Is Raw Water Metered?

Is Finished Water Ouput Metered?

Yes

Source

Groundwater

Did average daily water production exceed 80% of approved plant capacity for five consecutive days during 2022? No

If yes, was any water conservation implemented? No

Did average daily water production exceed 90% of approved plant capacity for five consecutive days during 2022? No

If yes, was any water conservation implemented? No


Are peak day demands expected to exceed the water treatment plant capacity in the next 10 years? No

## 4. Wastewater Information

**Monthly Discharges** 

Jamesville Water Plant

| Average Daily<br>Discharge (MGD) |        |     | Average Daily<br>Discharge (MGD) | Average Daily Discharge (MGD) |        |
|----------------------------------|--------|-----|----------------------------------|-------------------------------|--------|
| Jan                              | 0.0552 | May | 0.0310                           | Sep                           | 0.0345 |
| Feb                              | 0.0401 | Jun | 0.0295                           | Oct                           | 0.0402 |
| Mar                              | 0.0394 | Jul | 0.0395                           | Nov                           | 0.0373 |
| Apr                              | 0.0325 | Aug | 0.0394                           | Dec                           | 0.0433 |

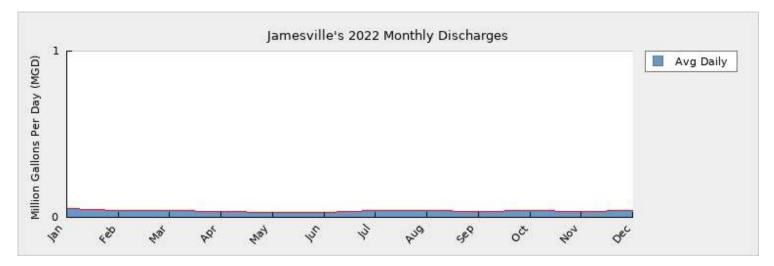

How many sewer connections does this system have? 193

How many water service connections with septic systems does this system have? 2

Are there plans to build or expand wastewater treatment facilities in the next 10 years? Yes

The Town will be receiving major upgrades to the wastewater facility in the next few years from a grant received in 2022.

**Wastewater Permits** 

| Permit<br>Number | Туре | Permitted<br>Capacity<br>(MGD) | Design<br>Capacity<br>(MGD) | Average Annual<br>Daily Discharge<br>(MGD) | Maximum Day<br>Discharge<br>(MGD) | Receiving<br>Stream | Receiving Basin         |
|------------------|------|--------------------------------|-----------------------------|--|-----------------------------------|---------------------|-------------------------|
| NC0035858        | WWTP | 0.1500                         | 0.1500                      | 0.0385                                     | 0.2000                            | Roanoke River       | Roanoke River<br>(14-1) |

# 5. Planning

**Projections** 

|                       | 2022   | 2030   | 2040   | 2050   | 2060   | 2070   |
|-----------------------|--------|--------|--------|--------|--------|--------|
| Year-Round Population | 440    | 440    | 441    | 441    | 442    | 442    |
| Seasonal Population   | 0      | 0      | 0      | 0      | 0      | 0      |
|                       |        |        |        |        |        |        |
| Residential           | 0.0156 | 0.0156 | 0.0156 | 0.0156 | 0.0156 | 0.0156 |
| Commercial            | 0.0047 | 0.0047 | 0.0047 | 0.0047 | 0.0047 | 0.0047 |

| Industrial                   | 0.0012 | 0.0012 | 0.0012 | 0.0012 | 0.0012 | 0.0012 |
|------------------------------|--------|--------|--------|--------|--------|--------|
| Institutional                | 0.0002 | 0.0002 | 0.0002 | 0.0002 | 0.0002 | 0.0002 |
| System Process               | 0.0058 | 0.0058 | 0.0058 | 0.0058 | 0.0058 | 0.0058 |
| Unaccounted-for              | 0.0035 | 0.0035 | 0.0035 | 0.0035 | 0.0035 | 0.0035 |
| Demand v/s Percent of Supply |        |        |        |        |        |        |
|                              | 2022   | 2030   | 2040   | 2050   | 2060   | 2070   |
| Surface Water Supply         | 0.0000 | 0.0000 | 0.0000 | 0.0000 | 0.0000 | 0.0000 |
| Ground Water Supply          | 0.1440 | 0.1440 | 0.1440 | 0.1440 | 0.1440 | 0.1440 |
| Purchases                    | 0.0000 | 0.0000 | 0.0000 | 0.0000 | 0.0000 | 0.0000 |
| Future Supplies              |        | 0.0000 | 0.0000 | 0.0000 | 0.0000 | 0.0000 |
| Total Available Supply (MGD) | 0.1440 | 0.1440 | 0.1440 | 0.1440 | 0.1440 | 0.1440 |
| Service Area Demand          | 0.0310 | 0.0310 | 0.0310 | 0.0310 | 0.0310 | 0.0310 |
| Sales                        | 0.0000 | 0.0000 | 0.0000 | 0.0000 | 0.0000 | 0.0000 |
| Future Sales                 |        | 0.0000 | 0.0000 | 0.0000 | 0.0000 | 0.0000 |
| Total Demand (MGD)           | 0.0310 | 0.0310 | 0.0310 | 0.0310 | 0.0310 | 0.0310 |
| Demand as Percent of Supply  | 22%    | 22%    | 22%    | 22%    | 22%    | 22%    |



The purpose of the above chart is to show a general indication of how the long-term per capita water demand changes over time. The per capita water demand may actually be different than indicated due to seasonal populations and the accuracy of data submitted. Water systems that have calculated long-term per capita water demand based on a methodology that produces different results may submit their information in the notes field.

Your long-term water demand is 35 gallons per capita per day. What demand management practices do you plan to implement to reduce the per capita water demand (i.e. conduct regular water audits, implement a plumbing retrofit program, employ practices such as rainwater harvesting or reclaimed water)? If these practices are covered elsewhere in your plan, indicate where the practices are discussed here.

Are there other demand management practices you will implement to reduce your future supply needs?

What supplies other than the ones listed in future supplies are being considered to meet your future supply needs?

How does the water system intend to implement the demand management and supply planning components above?

#### Additional Information

Has this system participated in regional water supply or water use planning? Yes, CCPCUA

What major water supply reports or studies were used for planning? CCPCUA

Please describe any other needs or issues regarding your water supply sources, any water system deficiencies or needed improvements (storage, treatment, etc.) or your ability to meet present and future water needs. Include both quantity and quality considerations, as well as financial, technical, managerial, permitting, and compliance issues: Radio read meters and distribution upgrades.

The Division of Water Resources (DWR) provides the data contained within this Local Water Supply Plan (LWSP) as a courtesy and service to our customers. DWR staff does not field verify data. Neither DWR, nor any other party involved in the preparation of this LWSP attests that the data is completely free of errors and omissions. Furthermore, data users are cautioned that LWSPs labeled **PROVISIONAL** have yet to be reviewed by DWR staff. Subsequent review may result in significant revision. Questions regarding the accuracy or limitations of usage of this data should be directed to the water system and/or DWR.